

TECHNICAL UPDATE

LIFT PIT TANKING DETAILS



Lift Pit Tanking Details

Introduction: This Technical Update article provides guidance on suitable lift pit tanking details. It is important that all workmanship carried out during construction be completed in accordance with the relevant tolerances.

The article covers:

1. Introduction
2. Lift pits constructed with masonry walls
3. Lift pits constructed with concrete walls

1. Introduction

This guidance provides a solution for the structural waterproofing of lift pits, on sites where there are no other structural waterproofing requirements [i.e. no basements or semi-basements and only a lift pit] and therefore the need for a Certified Surveyor in Structural Waterproofing to be engaged will not be necessary.

However, where a scheme contains a semi-basement or full basement scenario, the functional requirements of [Section 2 of the Technical Manual](#) prevail and a Waterproofing Specialist must take responsibility for the overall design liability of the waterproofing system, including any lift pits. The Waterproofing Specialist must have appropriate professional indemnity cover which covers their business activities. They must also have an understanding of hydrogeology and soil mechanics and hold a relevant professional qualification i.e. Certificated Surveyor in Structural Waterproofing (CSSW).

Please note these designs still require, additional information to be gained by our Risk Management Surveyor in order to fully mitigate our insurance risk on a site by site basis.


TECHNICAL UPDATE

LIFT PIT TANKING DETAILS

2. Lift pits constructed with masonry walls

Masonry lift pit tanking

Waterproofing to achieve Grade 2 protection in accordance with BS 8102:2009

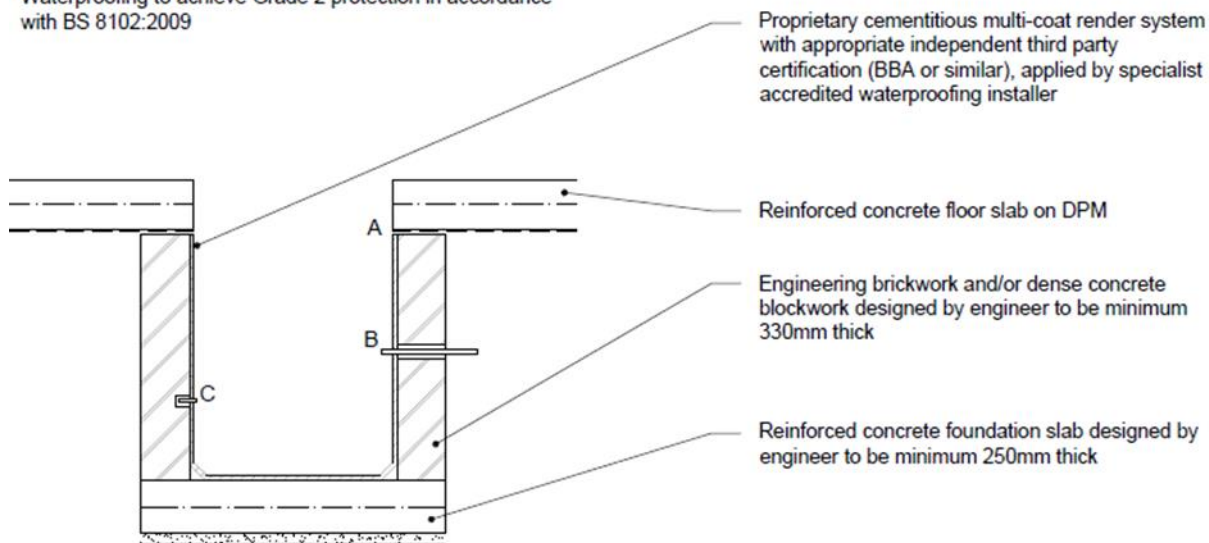

The following waterproofing details must be installed in accordance with a specialist design using proprietary products that are compatible with the multi-coat render system:

- A - Junction between DPM and Render system
- B - Service penetrations
- C - Surface fixings

For this situation our Risk Management Surveyor will need to gain the following information, for appraisal:

- A copy of the structural design for the lift pit, to check it meets the above minimum criteria.
- Details of the 3rd party accreditation (BBA or similar) for the cementitious multi-coat render system, for appraisal.
- Details relating to points A, B & C above, for appraisal.

Where the construction of the lift pit deviates from these minimum requirements, a CSSW Waterproofing Specialist, must be employed to design the structural waterproofing.

TECHNICAL UPDATE


LIFT PIT TANKING DETAILS



3. Lift pits constructed with concrete walls

Lift pit tanking

To be designed to Grade 2 protection in accordance with BS 8102:2009

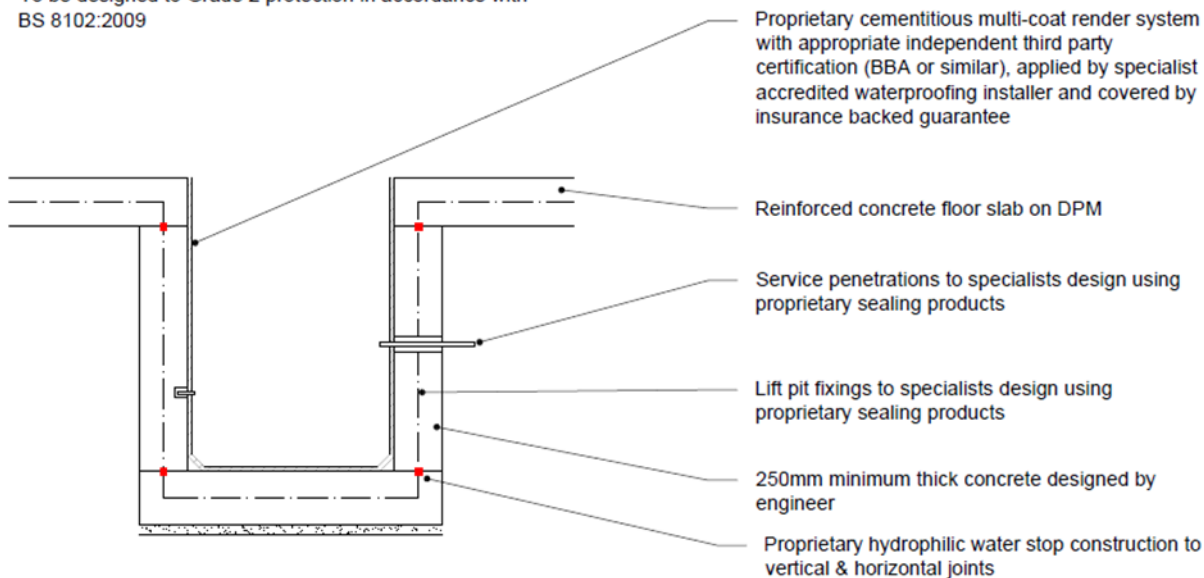

For this situation our Risk Management Surveyor will need to gain the following information, for appraisal:

- A copy of the structural design for the lift pit, to check it meets the above minimum criteria.
- Details of the 3rd party accreditation (BBA or similar) for the cementitious multi-coat render system and hydrophilic water stops, for appraisal.
- Details relating to the junction between the DPM and lift pit wall to ensure water tightness, details of how service penetrations are to be sealed and how any fixings are to be installed through the cementitious multi-coat render to ensure water tightness, all for appraisal.

Where the construction of the lift pit deviates from these minimum requirements, a CSSW Waterproofing Specialist, must be employed to design the structural waterproofing.

Every care was taken to ensure information in this article was correct at the time of writing (November 2020). Guidance provided does not replace the reader's professional judgement and any construction project should comply with the relevant Building Regulations or applicable technical standards. For the most up to date LABC Warranty technical guidance please refer to your Risk Management Surveyor and the [LABC Warranty technical manual](#).